



WD – WDF ***Vertical, Single-Stage Nuclear RHR Pump***

ASME Section III, Class 2 and 3




Experience In Motion

WD-WDF

Vertical, Single-Stage Nuclear RHR Pump

ASME Section III,
Class 2 and 3

Introduced in the 1970s, WD and WDF vertical, single-stage, diffuser-style pumps have established an excellent record of reliability in residual heat removal (RHR) applications in nuclear power stations around the globe. They have been continuously upgraded to meet the evolving safety and performance criteria of successive reactor design generations. Now featuring a removable spacer coupling to facilitate seal and bearing maintenance, current WD and WDF models are designed to meet the requirements of advanced pressurized water reactors (PWR) in terms of safety, reliability (extended MTBR), reduced maintenance costs and man-rem exposure (ALARA).

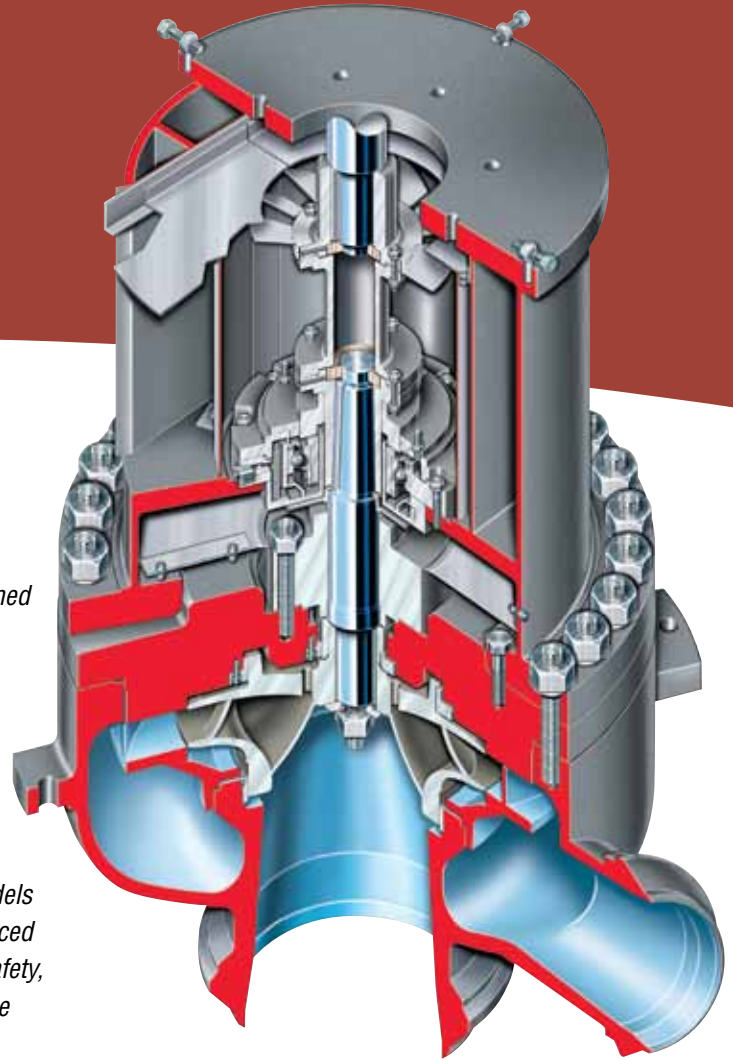

Operating Parameters

- Flows to 900 m³/h (4000 gpm)
- Heads to 245 m (800 ft)
- Pressures to 41 bar (600 psi)
- Temperatures to 205°C (400°F)

Features and Benefits

Heavy-duty Motor Support Head with large access openings permits quick in situ maintenance and removal of the spacer coupling, bearing housing, bearing and mechanical seal without removing the motor or casing cover. Its robust construction effectively dampens vibration to extend seal and bearing life.

Removable Four-piece Spacer Coupling provides easy access to the bearing and mechanical seal for removal or maintenance. The precision-machined and matchmarked coupling is secured to the shaft with reverse thread nuts.

Single Row Radial Bearing is oil lubricated and cooled with a fan flinger to achieve extended service life.

Cartridge Type, Single Mechanical Seal with integral disaster bushing and tungsten carbide and carbon seal faces offers proven reliability. Seal replacement can be accomplished without motor or pump casing removal.

Robust Rotor features a radial bearing located between the spacer coupling and mechanical seal. With its large shaft diameter and tapered fit at the coupling hub, this design reduces deflection and vibration for improved bearing and mechanical seal life.

Cast (WD) or Forged (WDF) Stainless Steel Casing With Diffuser effectively converts velocity head to pressure, thereby optimizing hydraulic performance.

Replaceable Wear Rings extend casing life and may be removed without disturbing piping connections.

Compact Footprint addresses space limitations inside containment.



Significant Functional Design Advantages

Simplified Maintenance

The four-piece spacer coupling greatly simplifies maintenance projects into routine chores. For example, mechanical seal replacement can be accomplished in 16 hours or less. The motor need not be removed from its mount, nor piping broken. No overhead cranes are required. These are significant advantages in the typically difficult work constraints found within containment.

Reduced Radiation Exposure Environment

Reduced maintenance time equals reduced man-rem. With the WD and WDF, seal replacement is estimated at less than one man-rem. Since the pump casing is not disassembled, there is no exposure to contaminated pump internals during routine maintenance.

Improved Reliability


The robust designs of the WD and WDF assures extended mean time between repair (MTBR). The pumps' bearing configuration and motor support head construction provide:

- Reduced loads on motor bearings
- Reduced rotor deflection at low flows
- Improved mechanical seal life

Stringent Qualification Analyses

Pump qualification includes:

- Certified critical speed analysis and natural frequency calculations (finite element modeling with all applicable motor weights)
- Seismic integrity and operability analyses (support and pressure boundary stresses, shaft stress and deflection, bearing loads, generic nozzle and seismic loads)

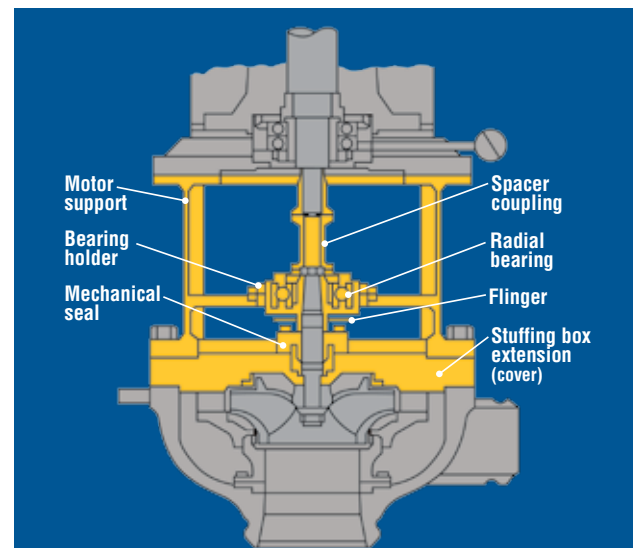


Upgrade Existing W, WD and WDF Pumps

Existing W, WD and WDF pumps may be cost-effectively upgraded to the current design, allowing pump owners and operators to take advantage of the simplified maintenance, reduced man-rem exposure and improved reliability that it offers.

The upgrade requires seven major new components (shown above in yellow) and may be quickly implemented via the following steps:

1. Disassemble the stuffing box extension from the pump case.
2. Remove the impeller.
3. Re-machine the motor shaft.
4. Reassemble the pump, incorporating all new components.

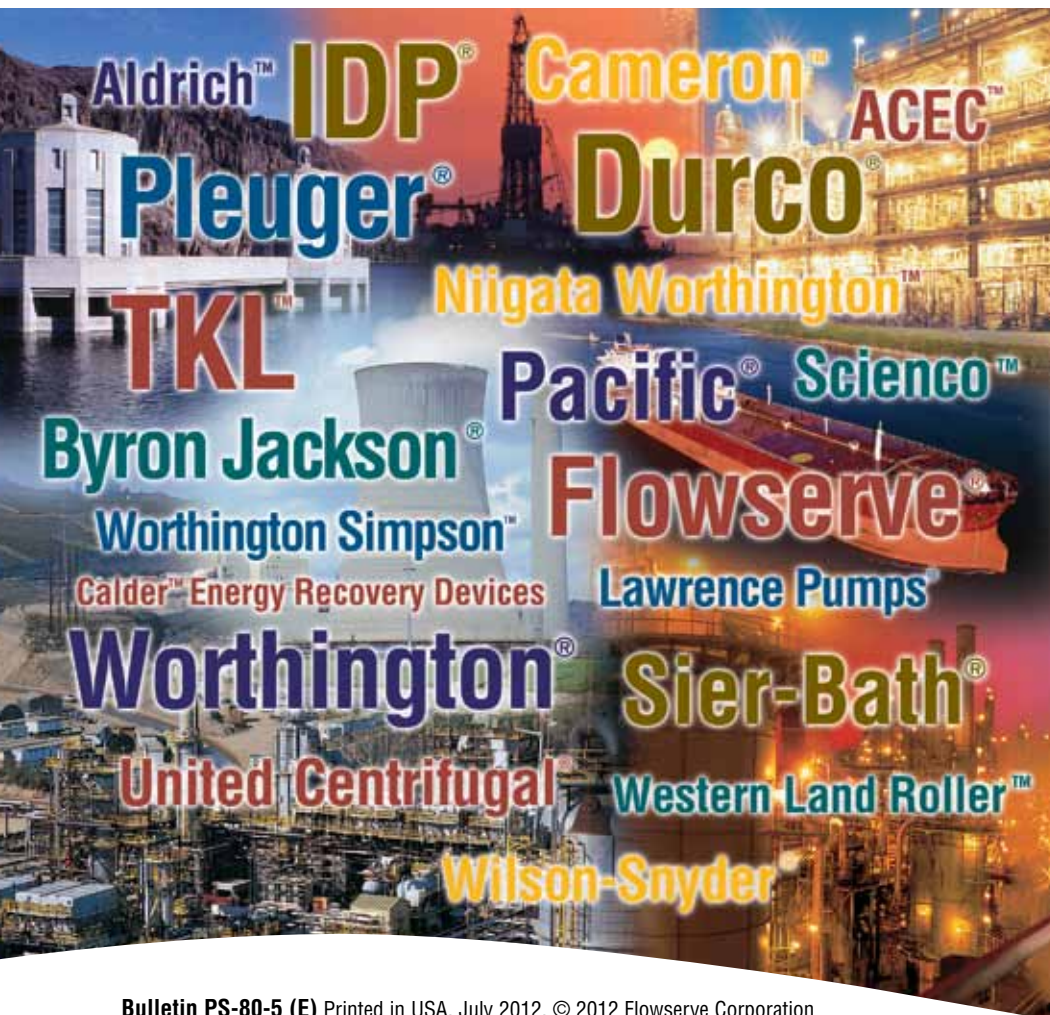

USA and Canada

Flowserve Corporation
5215 North O'Connor Blvd.
Suite 2300
Irving, Texas 75039-5421 USA
Telephone: +1 937 890 5839

Europe, Middle East, Africa

Flowserve Corporation
Parallelweg 13
4878 AH Etten-Leur
The Netherlands
Telephone: +31 76 502 8100

Latin America

Flowserve Corporation
Martín Rodríguez 4460
B1644CGN-Victoria-San Fernando
Buenos Aires, Argentina
Telephone: +54 11 4006 8700
Telefax: +54 11 4714 1610

Asia Pacific

Flowserve Pte. Ltd.
10 Tuas Loop
Singapore 637345
Telephone: +65 6771 0600
Telefax: +65 6862 2329

Bulletin PS-80-5 (E) Printed in USA. July 2012. © 2012 Flowserve Corporation

To find your local Flowserve representative:

For more information about Flowserve Corporation,
visit www.flowserve.com or call +1 937 890 5839.